





- ① PLASTIC VALVE BOX TO PROVIDE ACCESS.
- ② 3M DBR/Y-6 SPLICE KIT OR EQUIVALENT DIRECT BURIAL SPLICE KIT
- ③ DIRECT BURIAL 1 PAIR, TWISTED SHIELDED CABLE. RECOMMENDED MINIMUM CONDUCTOR SIZE 18 AWG. RATED FOR DISTANCES UP TO 2,000 FT (610 M). ENSURE A SERVICE LOOP (EXTRA WIRE LENGTH) IS PROVIDED AT THE FLOW SENSOR IN CASE MAINTENANCE IS NEEDED
- ④ QS100 ULTRASONIC FLOW SENSOR
- ⑤ FLOW DIRECTION ARROW
- ⑥ GRAVEL - GRAVEL SHALL BE PLACED AT BOTTOM OF QS100 AND SHALL BE A MINIMUM OF 10-INCH THICK (10-INCH DEEP)


NOTE 1:
5Xs MEANS 5 TIMES PIPE'S INNER DIAMETER AND
10Xs MEANS 10 TIMES PIPE'S INNER DIAMETER

NOTE 2:
BURIED CABLE ENROUTE TO IRRIGATION CONTROLLER

NOTE 3:
PVC UNIONS OR COUPLERS ARE REQUIRED
FOR QS100 INSTALLATION

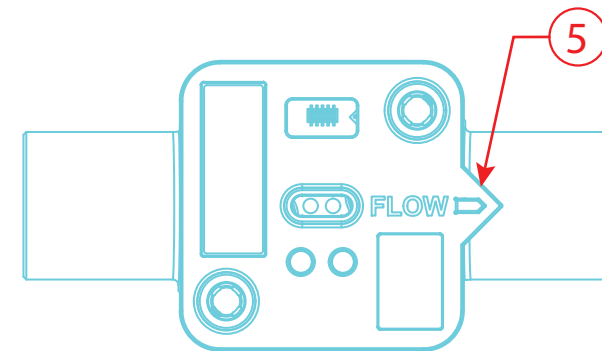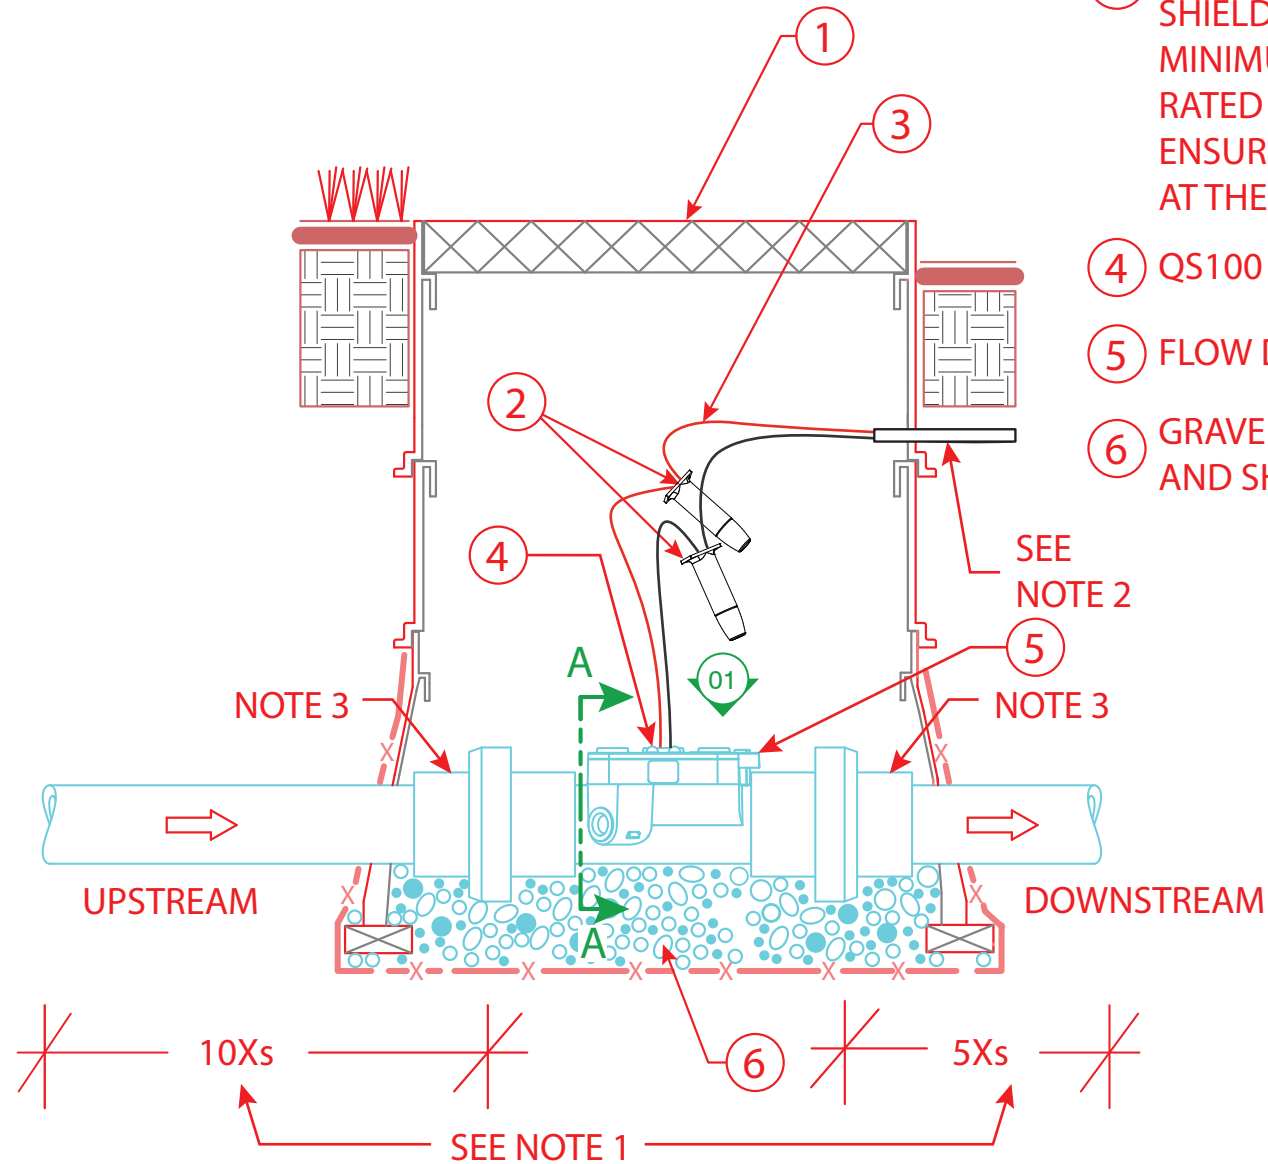

01 TOP VIEW
N.T.S.

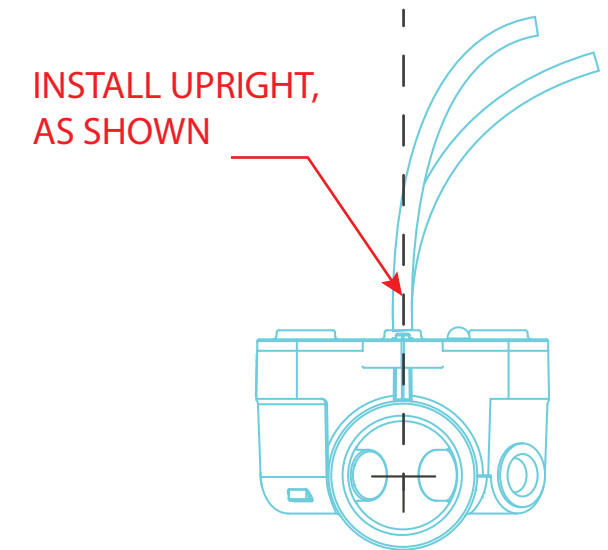

02 SECTION A-A
N.T.S.

00 FLOMEC FLOW SENSOR INSTALLATION
N.T.S.

IND-1125 REV-

QS100 FLOW SENSOR INSTALLATION

Wichita · Sydney

GREAT PLAINS INDUSTRIES



Great Plains Industries, Inc. / 888-996-3837 / FLOMEC.net
Great Plains Industries, Inc. Australia / +61 2 9540 4433 / FLOMEC.net